

NOTICE OF PRODUCT CERTIFICATION

Company: Therma-Tru Corporation
108 Mutzfeld Road
Butler, IN 46721

Certification No.: NI005335-R1
Certification Date: 10/15/2003
Expiration Date: 12/31/2009
Revision Date: 06/29/2007


Product: Premium Series Wood Edge Opaque Steel Door Inswing/Outswing w/ and w/o Sidelites
Specifications Tested To: ASTM E330/E331/TAS201/202/203

The "Notice of Product Certification" is only valid if the NAMI Certification Label has been applied to the product as described within this document. The certification label represents product conformity to the applicable specification and that all certification criteria has been satisfied. This product has been approved for listing within NAMI's Certified Product Listing at www.Namicertification.com. NAMI's Certification Program is accredited by The American National Standards Institute (ANSI).

Configuration	Inswing or Outswing	Glazed or Opaque	Maximum Size	Design Pressure Pos/Neg	Missile Impact Rated	Test Report Number & Comments
X Single	I/S	Opaque	3'0" x 6'8"	+75/-75	Yes	ETC-01-741-10639.0/PSI-202F/L-2150
X Single	O/S	Opaque	3'0" x 6'8"	+75/-75	Yes	ETC-01-741-10639.0/PSI-202F/L-2150
XX Double	I/S	Opaque	6'0" x 6'8"	+40/-40	Yes	ETC-01-741-10639.0/PSI-202F/L-2150 Standard Aluminum Astragal
XX Double	O/S	Opaque	6'0" x 6'8"	+40/-40	Yes	ETC-01-741-10639.0/PSI-202F/L-2150 Standard Aluminum Astragal
XX Double	I/S	Opaque	6'0" x 6'8"	+65/-65	Yes	ETC-01-741-10639.0/PSI-202F/L-2150 Coastal Aluminum Astragal
XX Double	O/S	Opaque	6'0" x 6'8"	+65/-65	Yes	ETC-01-741-10639.0/PSI-202F/L-2150 Coastal Aluminum Astragal
OXO/OX/XO Single w/Sidelites	I/S	Opaque Door Glazed Sidelites	5'4" x 6'8"	+65/-65	Door-Yes Sidelites-No	ETC-01-741-11006.0.0/PSI-202F/L-2149
OXO/OX/XO Single w/Sidelites	O/S	Opaque Door Glazed Sidelites	5'4" x 6'8"	+65/-65	Door-Yes Sidelites-No	ETC-01-741-11006.0.0/PSI-202F/L-2149
OXXO Double w/Sidelites	I/S	Opaque Doors Glazed Sidelites	8'4" x 6'8"	+40/-40	Doors-Yes Sidelites-No	ETC-01-741-11006.0.0/PSI-202F/L-2149 Standard Aluminum Astragal
OXXO Double w/Sidelites	O/S	Opaque Doors Glazed Sidelites	8'4" x 6'8"	+40/-40	Doors-Yes Sidelites-No	ETC-01-741-11006.0.0/PSI-202F/L-2149 Standard Aluminum Astragal
OXXO Double w/Sidelites	I/S	Opaque Doors Glazed Sidelites	8'4" x 6'8"	+65/-65	Doors-Yes Sidelites-No	ETC-01-741-11006.0.0/PSI-202F/L-2149 Coastal Aluminum Astragal
OXXO Double w/Sidelites	O/S	Opaque Doors Glazed Sidelites	8'4" x 6'8"	+65/-65	Doors-Yes Sidelites-No	ETC-01-741-11006.0.0/PSI-202F/L-2149 Coastal Aluminum Astragal

National Accreditation & Management Institute, Inc./11870 Merchants Walk, Suite 202/Newport News, VA 23606
Tel-757.594.8658/Fax-757.594.8659

NAMI AUTHORIZED SIGNATURE: _____

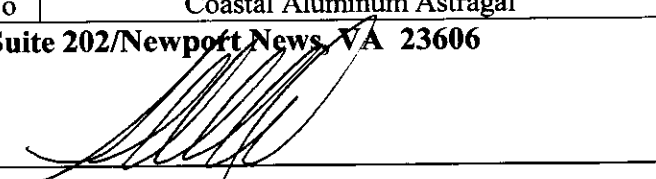

NOTICE OF PRODUCT CERTIFICATION

Company: Therma-Tru Corporation
 108 Mutzfeld Road
 Butler, IN 46721

Certification No.: NI005333-R1
Certification Date: 10/15/2003
Expiration Date: 12/31/2009
Revision Date: 06/29/2007


Product: Premium Series Wood Edge Glazed Steel Door Inswing/Outswing w/ and w/o Sidelites
 Specifications Tested To: ASTM E330/E331/TAS202

The "Notice of Product Certification" is only valid if the NAMI Certification Label has been applied to the product as described within this document. The certification label represents product conformity to the applicable specification and that all certification criteria has been satisfied. This product has been approved for listing within NAMI's Certified Product Listing at www.Namicertification.com. NAMI's Certification Program is accredited by The American National Standards Institute (ANSI).

Configuration	Inswing or Outswing	Glazed or Opaque	Maximum Size	Design Pressure Pos/Neg	Missile Impact Rated	Test Report Number & Comments
X Single	I/S	Glazed	3'0" x 8'0"	+45/-45	No	NCTL-210-2030-1/PSI-8204F
X Single	O/S	Glazed	3'0" x 8'0"	+45/-45	No	NCTL-210-2030-1/PSI-8204F
XX Double	I/S	Glazed	6'0" x 8'0"	+40/-40	No	NCTL-210-1917-1/PSI-8204F Standard Aluminum Astragal
XX Double	O/S	Glazed	6'0" x 8'0"	+40/-40	No	NCTL-210-1917-1/PSI-8204F Standard Aluminum Astragal
XX Double	I/S	Glazed	6'0" x 8'0"	+45/-45	No	NCTL-210-1917-1/PSI-8204F Coastal Aluminum Astragal
XX Double	O/S	Glazed	6'0" x 8'0"	+45/-45	No	NCTL-210-1917-1/PSI-8204F Coastal Aluminum Astragal
OXO/OX/XO Single w/Sidelites	I/S	Glazed Door Glazed Sidelites	5'4" x 8'0"	+45/-45	No	NCTL-210-2030-1/PSI-8204F
OXO/OX/XO Single w/Sidelites	O/S	Glazed Door Glazed Sidelites	5'4" x 8'0"	+45/-45	No	NCTL-210-2030-1/PSI-8204F
OXXO Double w/Sidelites	I/S	Glazed Doors Glazed Sidelites	8'4" x 8'0"	+40/-40	No	NCTL-210-1917-1/PSI-8204F Standard Aluminum Astragal
OXXO Double w/Sidelites	O/S	Glazed Doors Glazed Sidelites	8'4" x 8'0"	+40/-40	No	NCTL-210-1917-1/PSI-8204F Standard Aluminum Astragal
OXXO Double w/Sidelites	I/S	Glazed Doors Glazed Sidelites	8'4" x 8'0"	+45/-45	No	NCTL-210-1917-1/PSI-8204F Coastal Aluminum Astragal
OXXO Double w/Sidelites	O/S	Glazed Doors Glazed Sidelites	8'4" x 8'0"	+45/-45	No	NCTL-210-1917-1/PSI-8204F Coastal Aluminum Astragal

**National Accreditation & Management Institute, Inc./11870 Merchants Walk, Suite 202/Newport News, VA 23606
 Tel-757.594.8658/Fax-757.594.8659**

NAMI AUTHORIZED SIGNATURE: _____

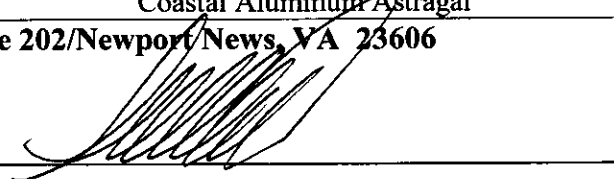

NOTICE OF PRODUCT CERTIFICATION

Company: Therma-Tru Corporation
 108 Mutzfeld Road
 Butler, IN 46721

Certification No.: NI005332-R1
Certification Date: 10/15/2003
Expiration Date: 12/31/2009
Revision Date: 06/29/2007


Product: Premium Series Wood Edge Opaque Steel Door Inswing/Outswing w/ and w/o Sidelites
 Specifications Tested To: ASTM E330/E331/TAS201/202/203

The "Notice of Product Certification" is only valid if the NAMI Certification Label has been applied to the product as described within this document. The certification label represents product conformity to the applicable specification and that all certification criteria has been satisfied. This product has been approved for listing within NAMI's Certified Product Listing at www.Namicertification.com. NAMI's Certification Program is accredited by The American National Standards Institute (ANSI).

Configuration	Inswing or Outswing	Glazed or Opaque	Maximum Size	Design Pressure Pos/Neg	Missile Impact Rated	Test Report Number & Comments
X Single	I/S	Opaque	3'0" x 8'0"	+45/-45	Yes	NCTL-210-2030-1/PSI-8205F
X Single	O/S	Opaque	3'0" x 8'0"	+45/-45	Yes	NCTL-210-2030-1/PSO-8205F
XX Double	I/S	Opaque	6'0" x 8'0"	+40/-40	Yes	NCTL-210-1917-1/PSI-8205F Standard Aluminum Astragal
XX Double	O/S	Opaque	6'0" x 8'0"	+40/-40	Yes	NCTL-210-1917-1/PSO-8205F Standard Aluminum Astragal
XX Double	I/S	Opaque	6'0" x 8'0"	+45/-45	Yes	NCTL-210-1917-1/PSI-8205F Coastal Aluminum Astragal
XX Double	O/S	Opaque	6'0" x 8'0"	+45/-45	Yes	NCTL-210-1917-1/PSO-8205F Coastal Aluminum Astragal
OXO/OX/XO Single w/Sidelites	I/S	Opaque Door Glazed Sidelites	5'4" x 8'0"	+45/-45	Door-Yes Sidelites-No	NCTL-210-2030-1/PSI-8205F
OXO/OX/XO Single w/Sidelites	O/S	Opaque Door Glazed Sidelites	5'4" x 8'0"	+45/-45	Door-Yes Sidelites-No	NCTL-210-2030-1/PSO-8205F
OXXO Double w/Sidelites	I/S	Opaque Doors Glazed Sidelites	8'4" x 8'0"	+40/-40	Doors-Yes Sidelites-No	NCTL-210-1917-1/PSI-8205F Standard Aluminum Astragal
OXXO Double w/Sidelites	O/S	Opaque Doors Glazed Sidelites	8'4" x 8'0"	+40/-40	Doors-Yes Sidelites-No	NCTL-210-1917-1/PSO-8205F Standard Aluminum Astragal
OXXO Double w/Sidelites	I/S	Opaque Doors Glazed Sidelites	8'4" x 8'0"	+45/-45	Doors-Yes Sidelites-No	NCTL-210-1917-1/PSI-8205F Coastal Aluminum Astragal
OXXO Double w/Sidelites	O/S	Opaque Doors Glazed Sidelites	8'4" x 8'0"	+45/-45	Doors-Yes Sidelites-No	NCTL-210-1917-1/PSO-8205F Coastal Aluminum Astragal

National Accreditation & Management Institute, Inc./11870 Merchants Walk, Suite 202/Newport News, VA 23606
 Tel-757.594.8658/Fax-757.594.8659

NAMI AUTHORIZED SIGNATURE: _____

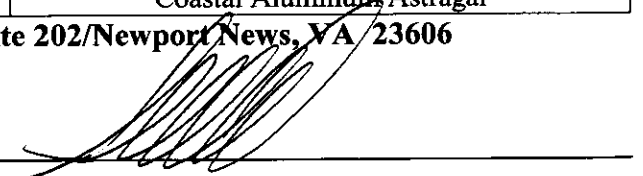

NOTICE OF PRODUCT CERTIFICATION

Company: Therma-Tru Corporation
 108 Mutzfeld Road
 Butler, IN 46721

Certification No.: NI005334-R1
Certification Date: 10/15/2003
Expiration Date: 12/31/2009
Revision Date: 06/29/2007

Product: Premium Series Wood Edge Glazed Steel Door Inswing/Outswing w/ and w/o Sidelites
 Specifications Tested To: ASTM E330/E331/TAS202

The "Notice of Product Certification" is only valid if the NAMI Certification Label has been applied to the product as described within this document. The certification label represents product conformity to the applicable specification and that all certification criteria has been satisfied. This product has been approved for listing within NAMI's Certified Product Listing at www.Namicertification.com. NAMI's Certification Program is accredited by The American National Standards Institute (ANSI).

Configuration	Inswing or Outswing	Glazed or Opaque	Maximum Size	Design Pressure Pos/Neg	Missile Impact Rated	Test Report Number & Comments
X Single	I/S	Glazed	3'0" x 6'8"	+47/-47	No	ETC-01-741-11004.0/CPSI-203F
X Single	O/S	Glazed	3'0" x 6'8"	+47/-47	No	ETC-01-741-11004.0/CPSI-203F
XX Double	I/S	Glazed	6'0" x 6'8"	+40/-40	No	ETC-01-741-11004.0/CPSI-203F Standard Aluminum Astragal
XX Double	O/S	Glazed	6'0" x 6'8"	+40/-40	No	ETC-01-741-11004.0/CPSI-203F Standard Aluminum Astragal
XX Double	I/S	Glazed	6'0" x 6'8"	+47/-47	No	ETC-01-741-11004.0/CPSI-203F Coastal Aluminum Astragal
XX Double	O/S	Glazed	6'0" x 6'8"	+47/-47	No	ETC-01-741-11004.0/CPSI-203F Coastal Aluminum Astragal
OXO/OX/XO Single w/Sidelites	I/S	Glazed Door Glazed Sidelites	5'4" x 6'8"	+47/-47	No	NCTL-210-2030-1/CPSI-203F
OXO/OX/XO Single w/Sidelites	O/S	Glazed Door Glazed Sidelites	5'4" x 6'8"	+47/-47	No	NCTL-210-2030-1/CPSI-203F
OXXO Double w/Sidelites	I/S	Glazed Doors Glazed Sidelites	8'4" x 6'8"	+40/-40	No	NCTL-210-2030-1/CPSI-203F Standard Aluminum Astragal
OXXO Double w/Sidelites	O/S	Glazed Doors Glazed Sidelites	8'4" x 6'8"	+40/-40	No	NCTL-210-2030-1/CPSI-203F Standard Aluminum Astragal
OXXO Double w/Sidelites	I/S	Glazed Doors Glazed Sidelites	8'4" x 6'8"	+47/-47	No	NCTL-210-2030-1/CPSI-203F Coastal Aluminum Astragal
OXXO Double w/Sidelites	O/S	Glazed Doors Glazed Sidelites	8'4" x 6'8"	+47/-47	No	NCTL-210-2030-1/CPSI-203F Coastal Aluminum Astragal

National Accreditation & Management Institute, Inc./11870 Merchants Walk, Suite 202/Newport News, VA 23606
 Tel-757.594.8658/Fax-757.594.8659

NAMI AUTHORIZED SIGNATURE: _____

